
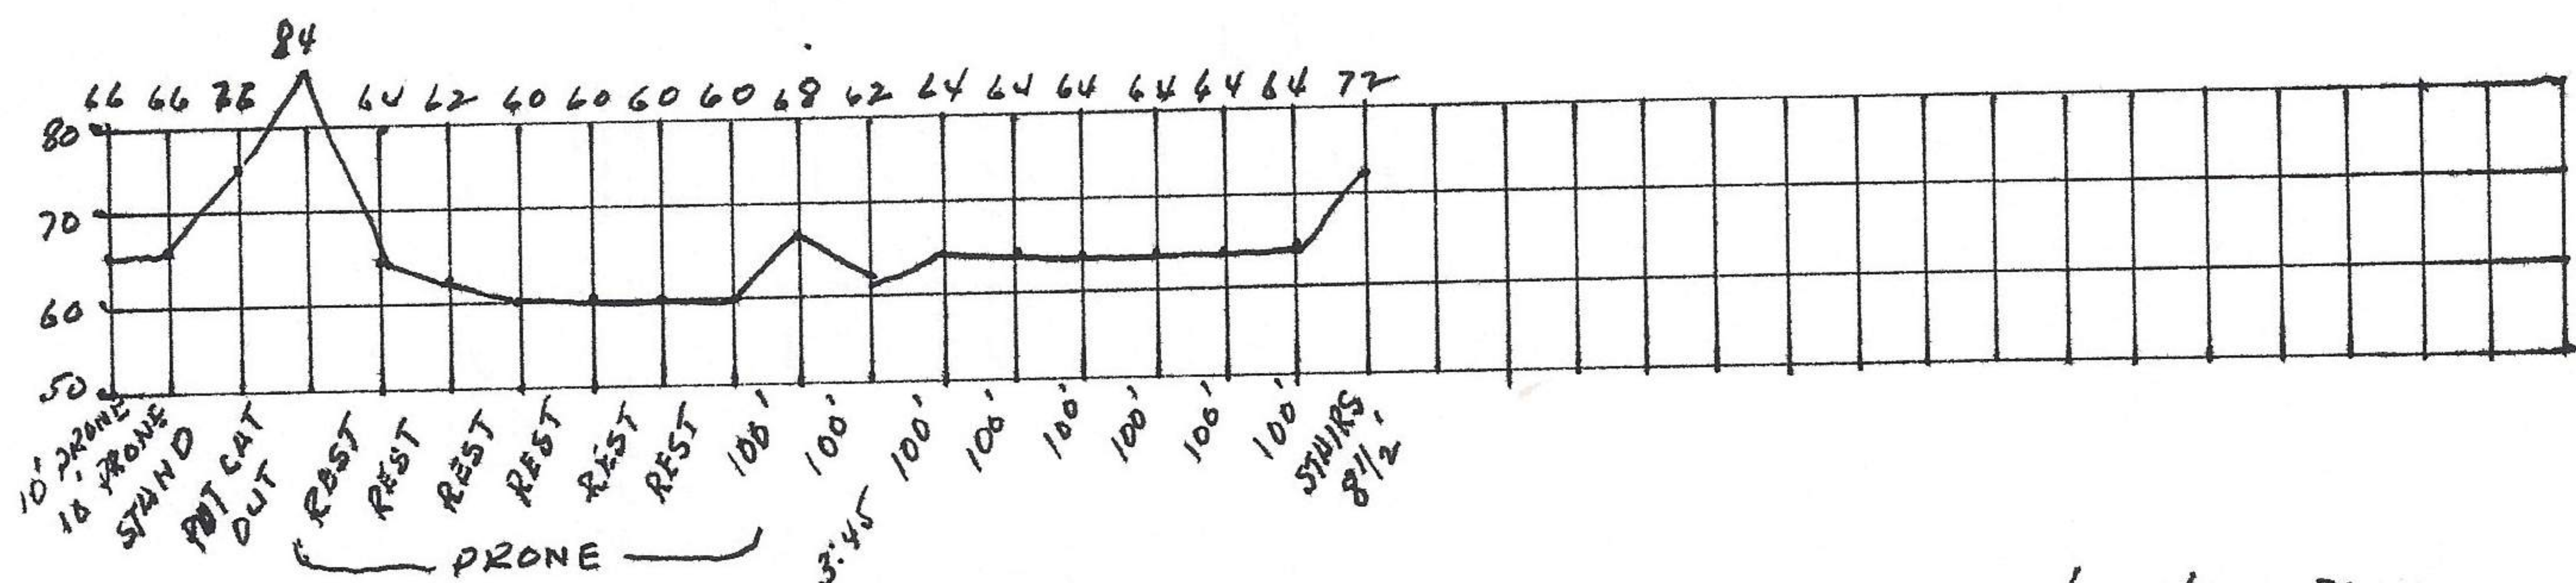



Recorded pulse under different stresses as baseline.

120/70 Gp. 7:00 A.M.

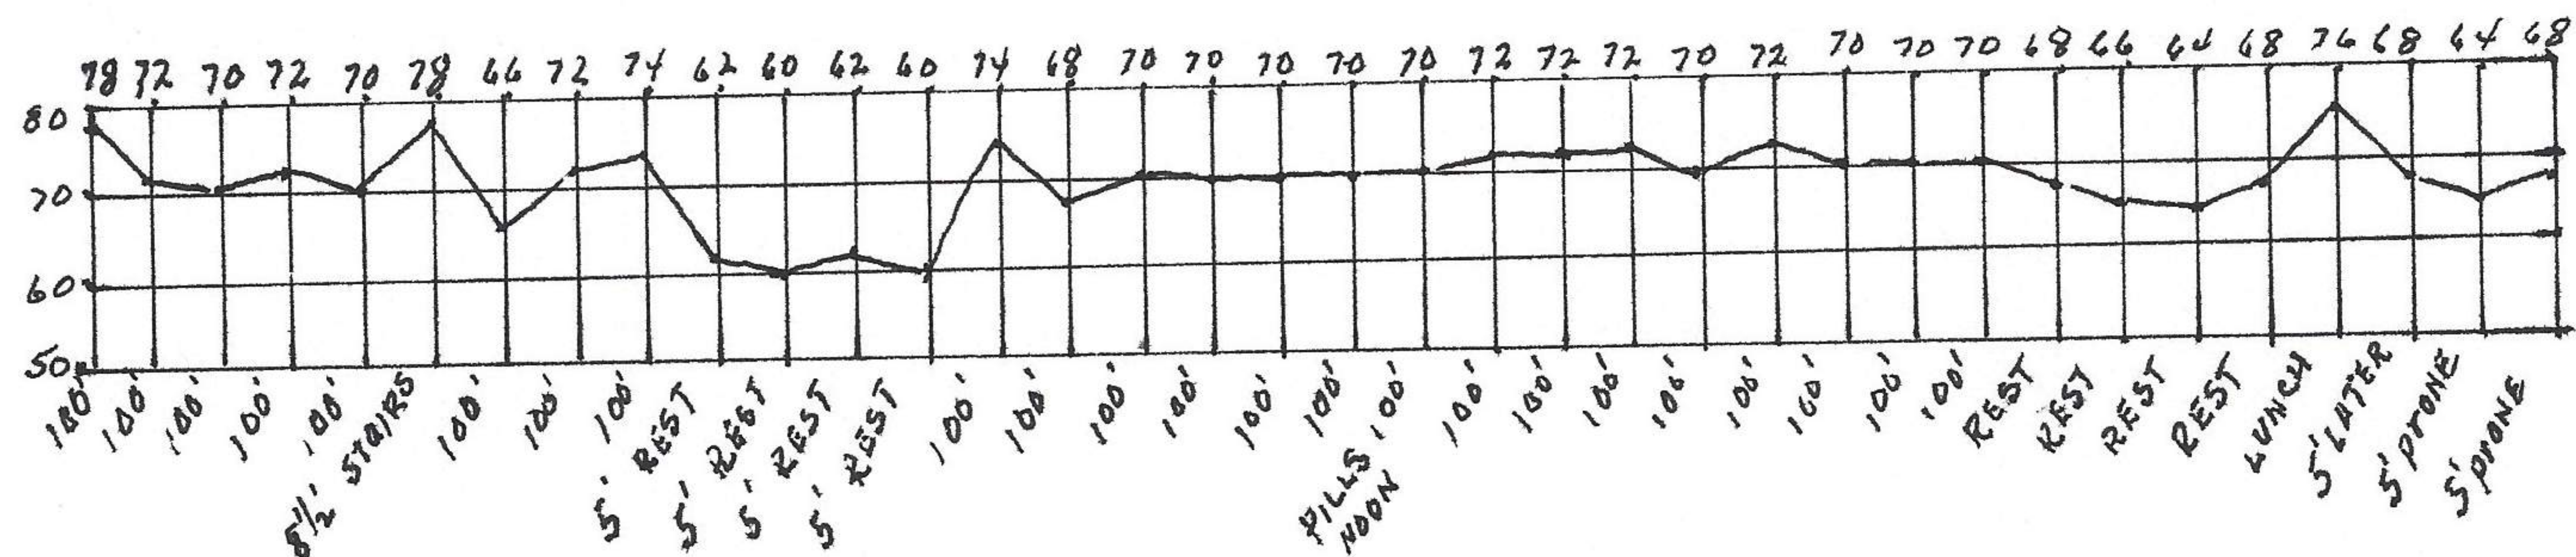

Dec. 8, 1979


130/70 bp. 7:00 A.M.

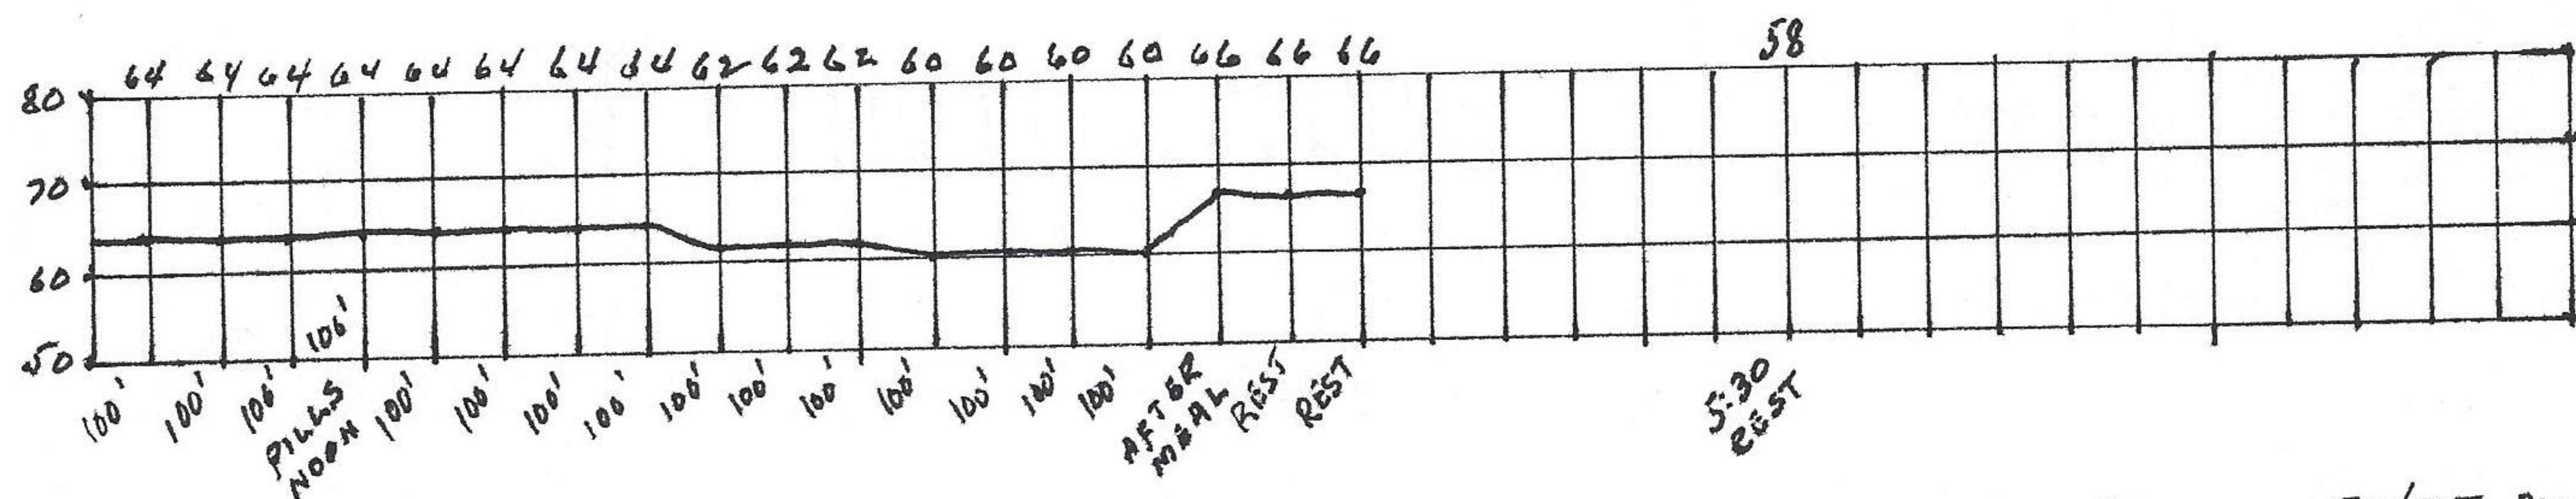

Dec. 9, 1979

Dec 10, 1979


150/75 2:00 A.M.

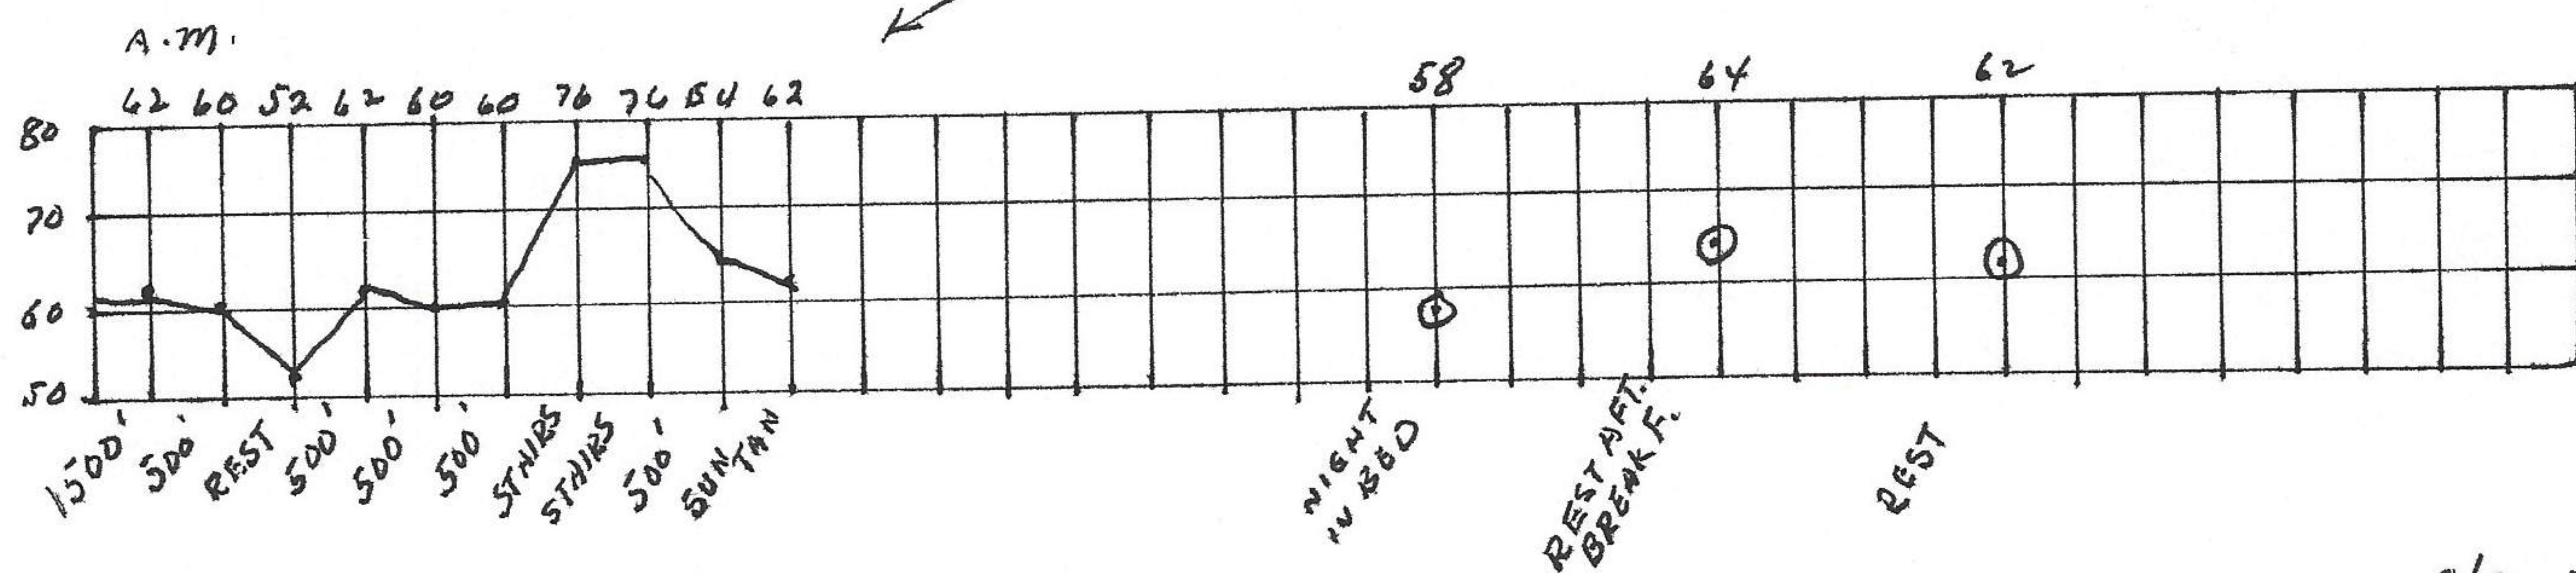

Dec. 11, 1979

Dec. 12. 1979

148/80 7:00
A.M.

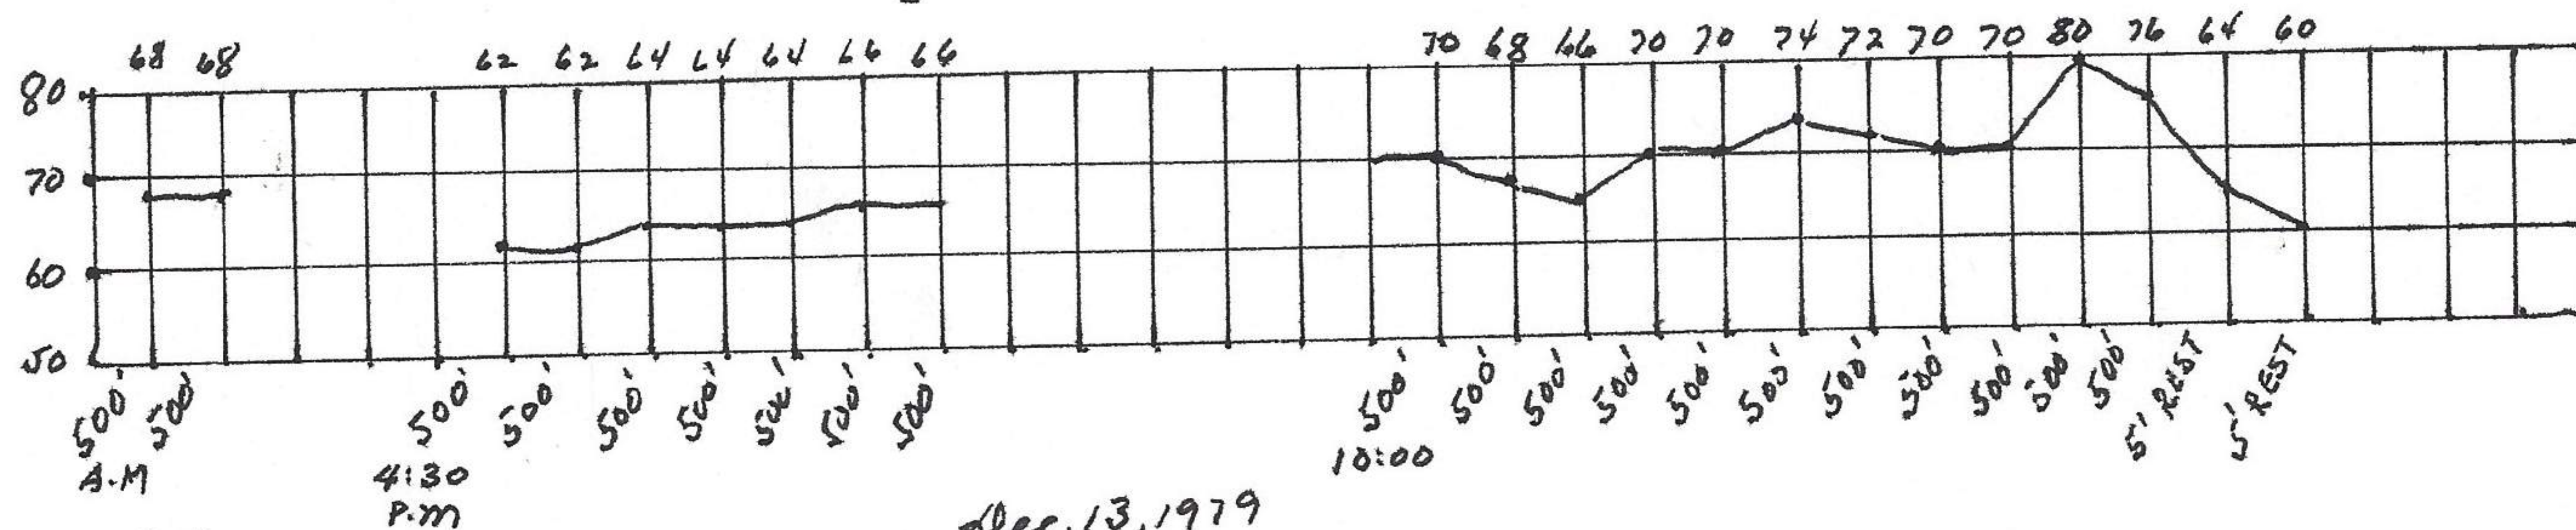

Dec. 13, 1979

